

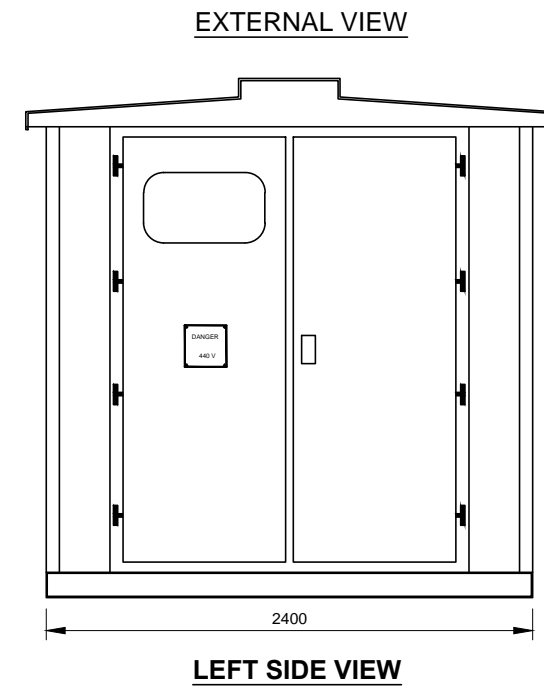
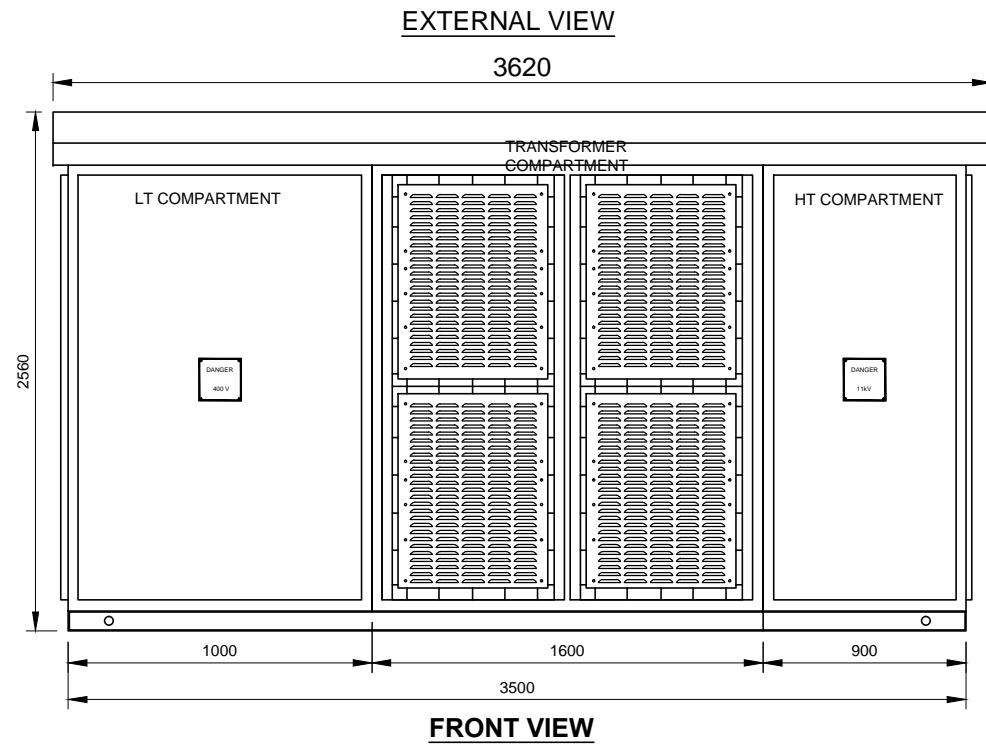



ANNEXURE - 1

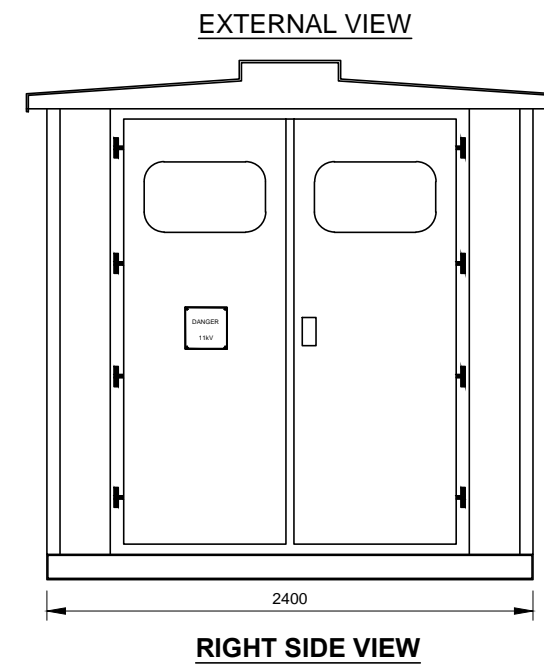

DEGREE OF PROTECTION FOR CSS
 1. HT & LT COMPARTMENT IS - IP65
 2. TRANSFORMER COMPARTMENT IS - IP23
 MATERIALS
 SHEET METALS : 2mm CRCA MATERIALS

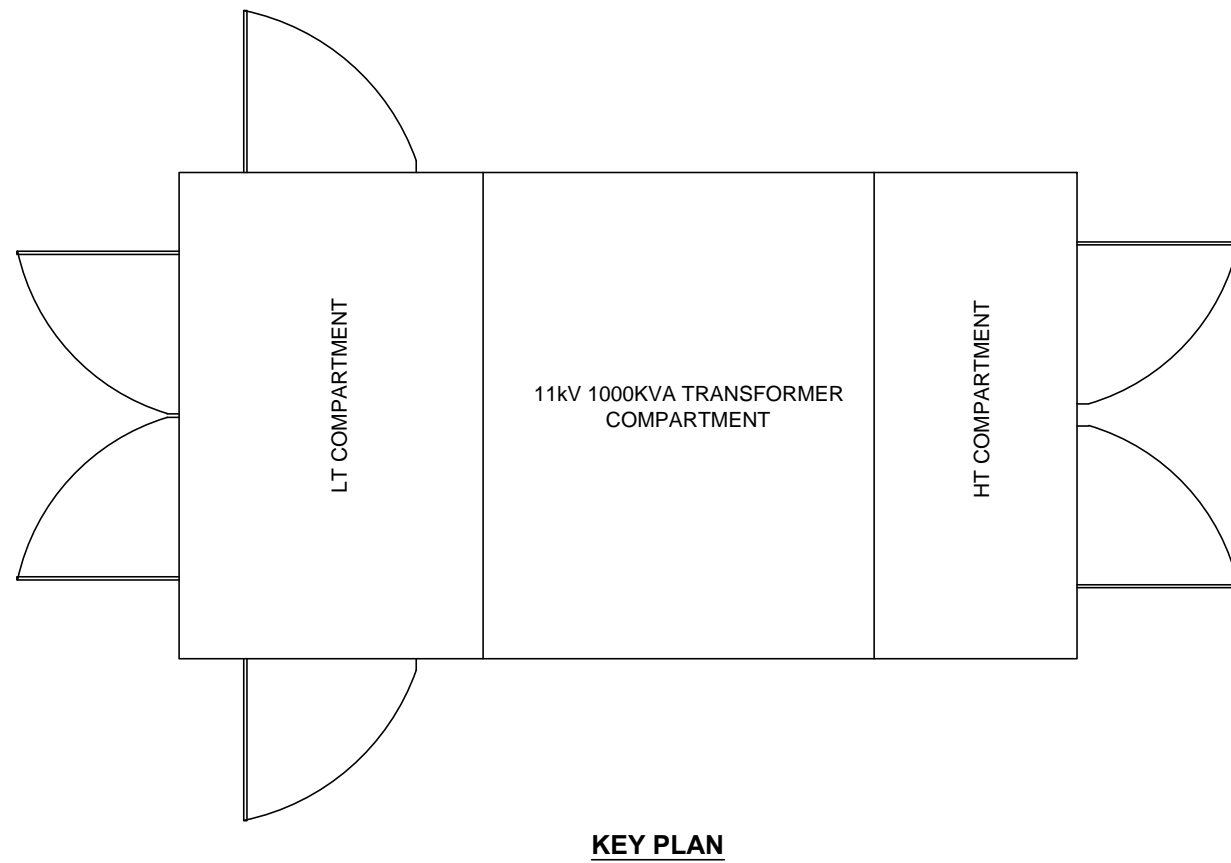

ALL DIMENSIONS ARE IN MM.

 AN ISO 9001:2015 CERTIFIED & ISIRI CODE COMPLIANT PORT		MORMUGAO PORT TRUST ENGG. MECH. DEPT.			
		ENCLOSURE FOR 11KV 1000KVA COMPACT SUBSTATION			
DATE	02-04-2018	DRG. NO.	20180402-2	REV. 1	Sheet 1/1
SCALE	N.T.S				